



DRAWING NUMBER
A-105
Cantor
11-2


DRAWING NUMBER
PLAN HOLD CORPORATION • IRVINE, CALIFORNIA
REPRODUCED BY MEANS OF PHOTOGRAPHY
REPRODUCED BY MEANS OF PHOTOGRAPHY

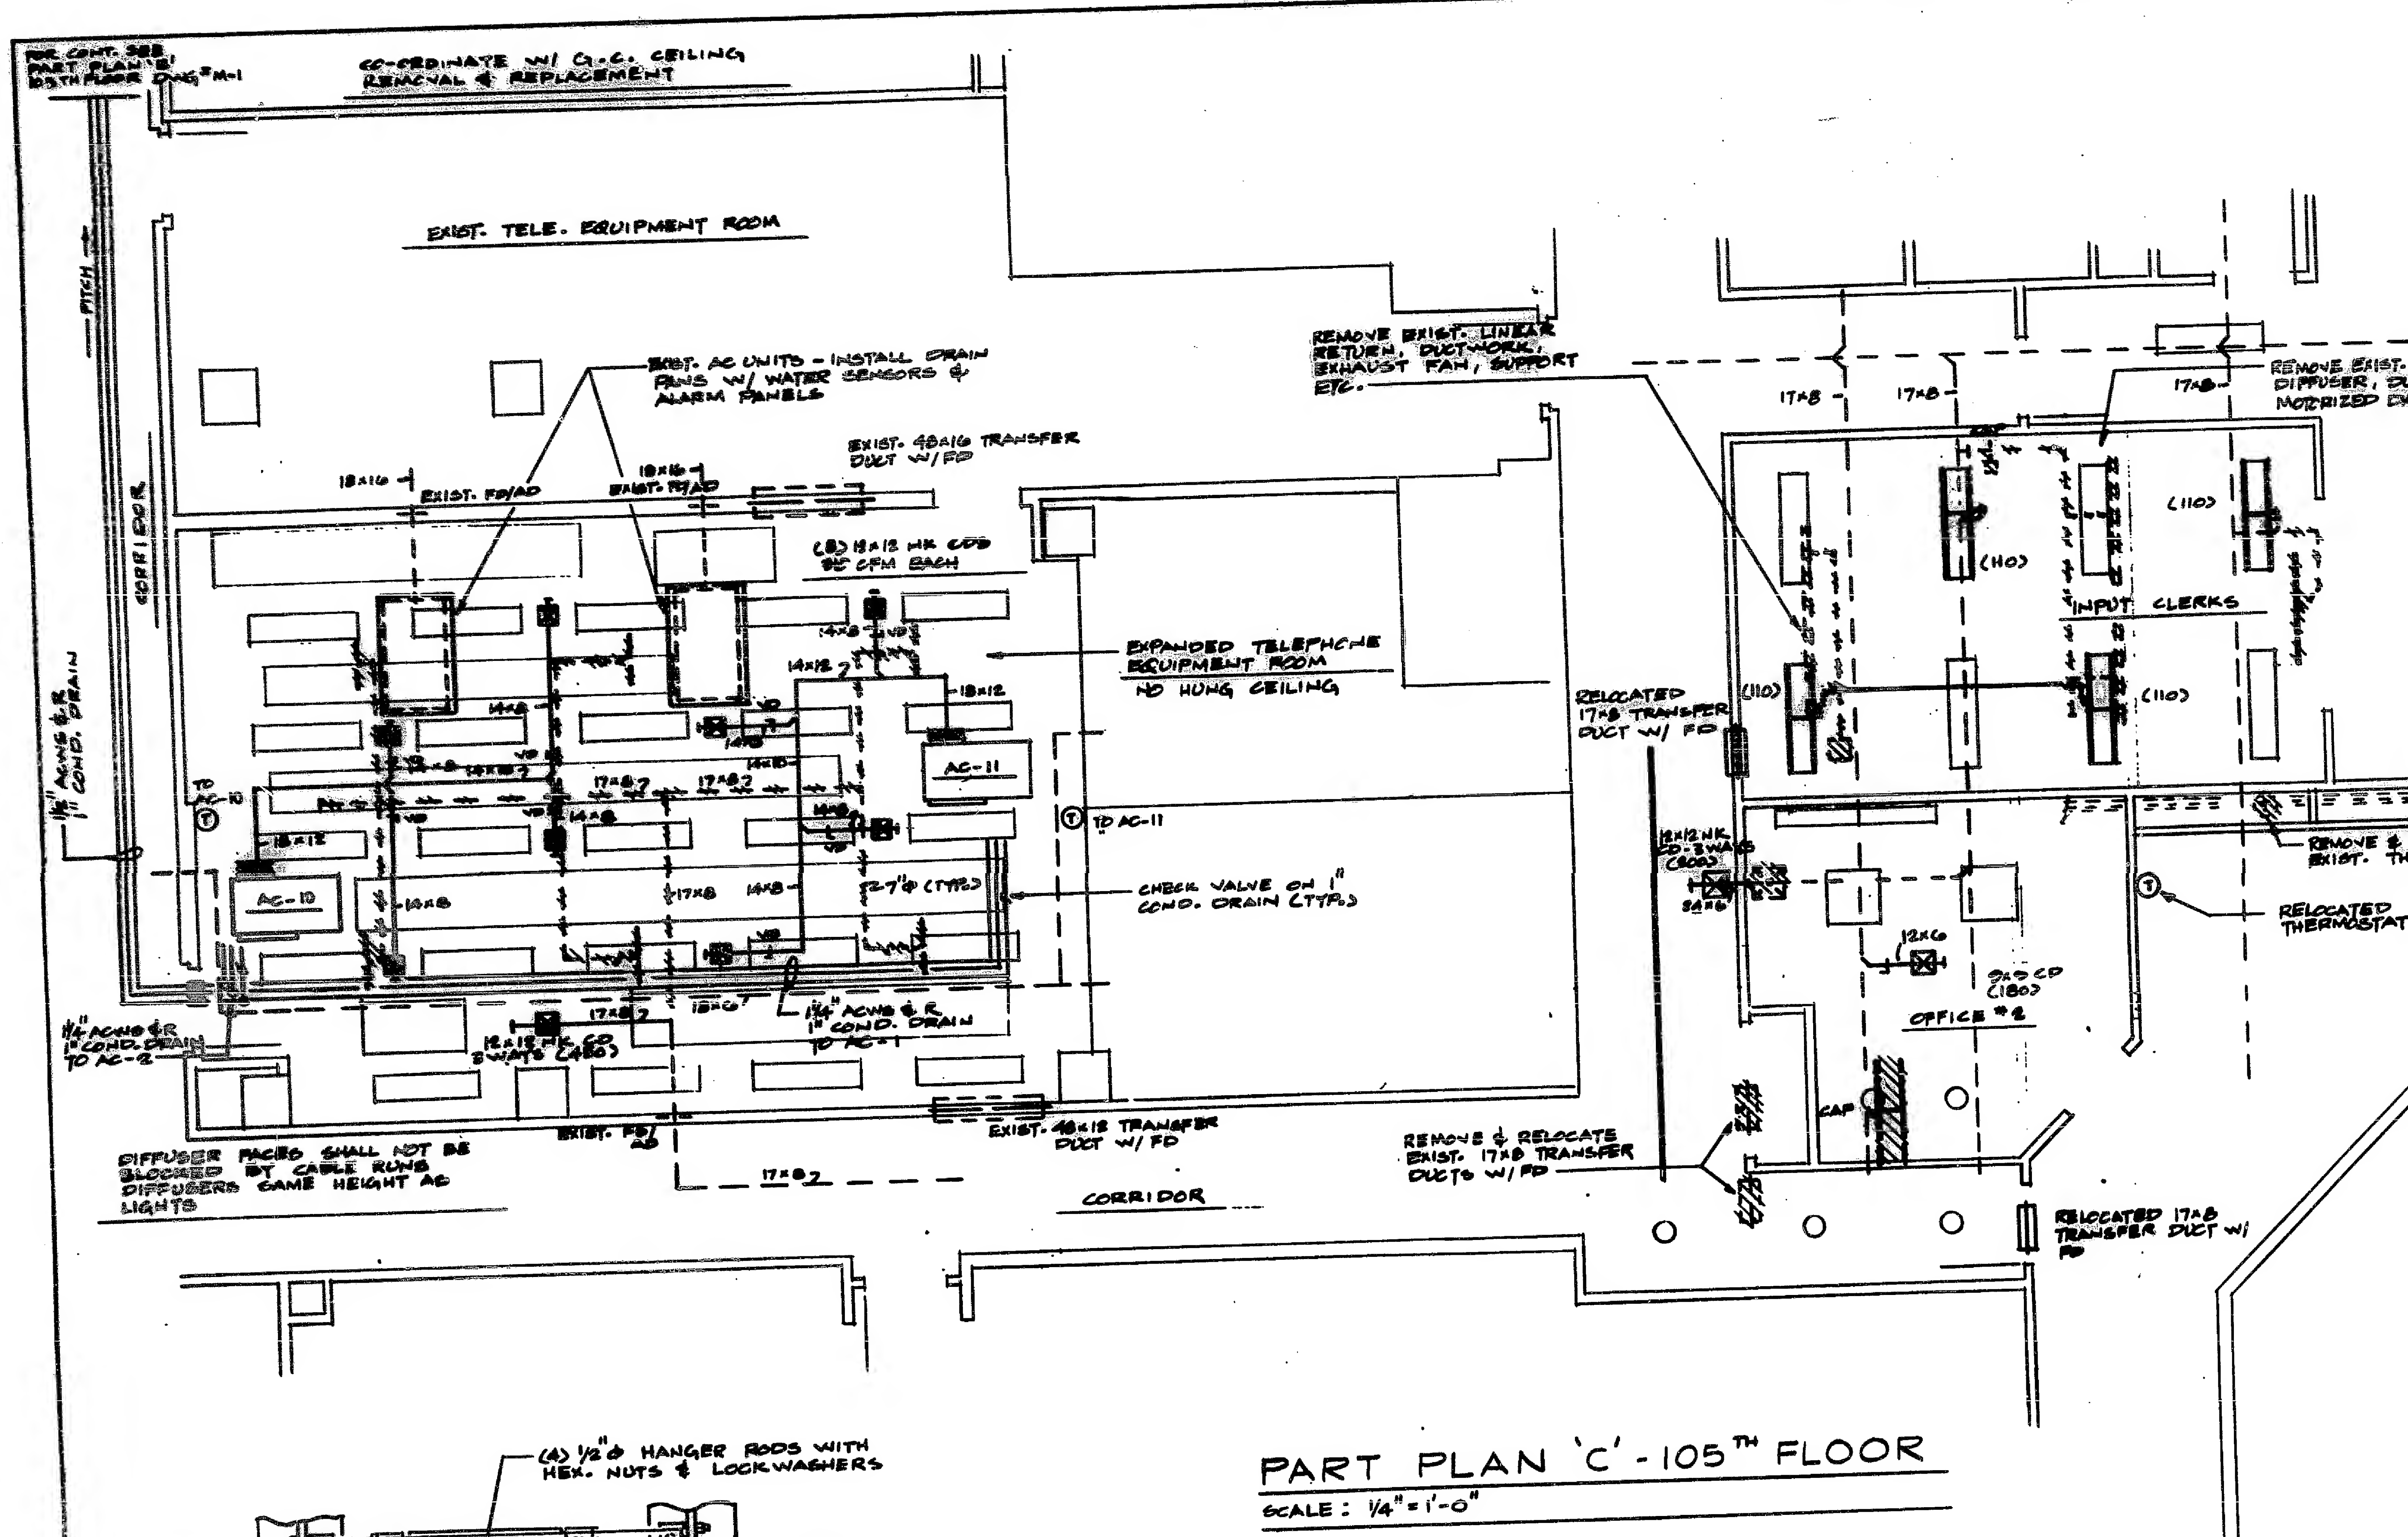

PART PLAN 'C' - 105TH FLOOR
SCALE: 1/4" = 1'-0"

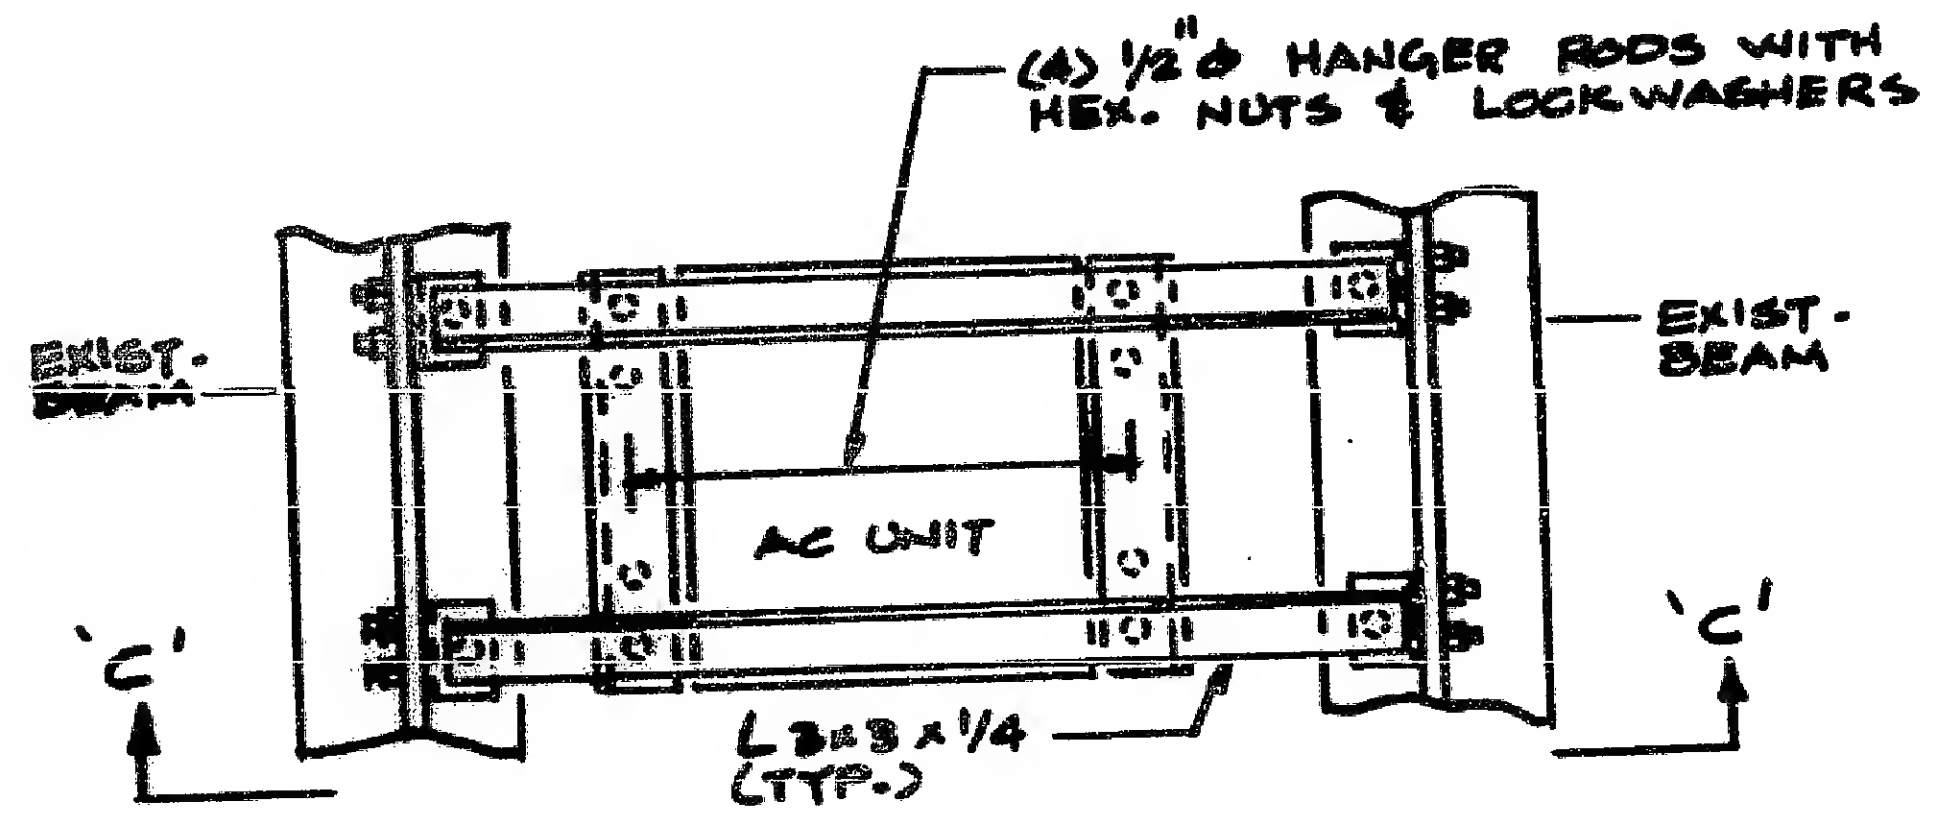

PLAN
NO SCALE

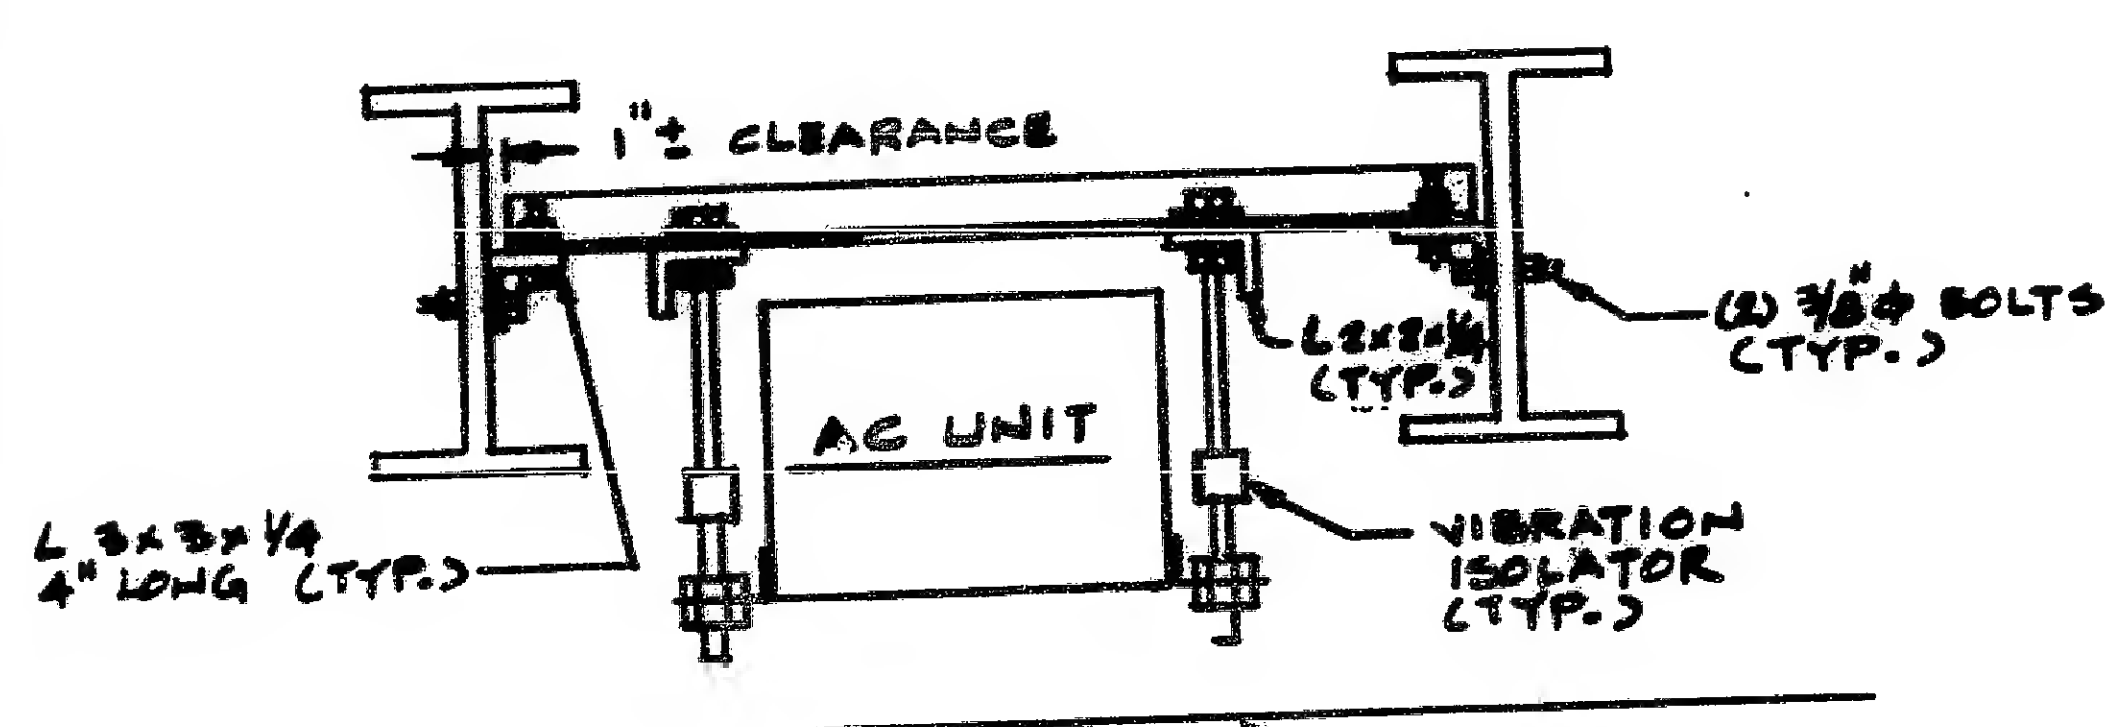

SECTION 'C'-C'
NO SCALE

AC UNIT HANGING DETAIL (AC-10+11)
NO SCALE

NYC VENTILATION INDEX							
ROOM	AREA X 10	VOLUME	NO. OF PEOPLE	VENTILATION INDEX	REQ'D CFM / SQ. FT. SUPPLY	EXHAUST	DESIGN SUPPLY
TRADING ROOM DWG-H	12480	10000	41	503	0.9	0.9	2.3
EXPANDED TEL. ROOM	7360	6171	2	6715	0.4	0.4	4.0
OFFICE #1	1560	1320	1	5586	0.4	0.4	0.76
OFFICE #2	1690	1486	1	3120	0.4	0.4	1.1
INPUT CLERKS	2902	2467	11	488	1.2	1.2	1.5
REC. CAGE - EXPAN.	4680	3962	10	800	0.6	0.6	0.8

THESE ARE RE-CIRCULATED AIR CONDITIONING SYSTEMS
MINIMUM OUTSIDE AIR EQUALS TO 35% OF REQ'D AIR

DRAWING NUMBER
PLAN HOLD CORPORATION • IRVINE, CALIFORNIA
REPRODUCED BY MEANS OF PHOTOGRAPHY
REPRODUCED BY MEANS OF PHOTOGRAPHY